



Jøtul F 405


Product

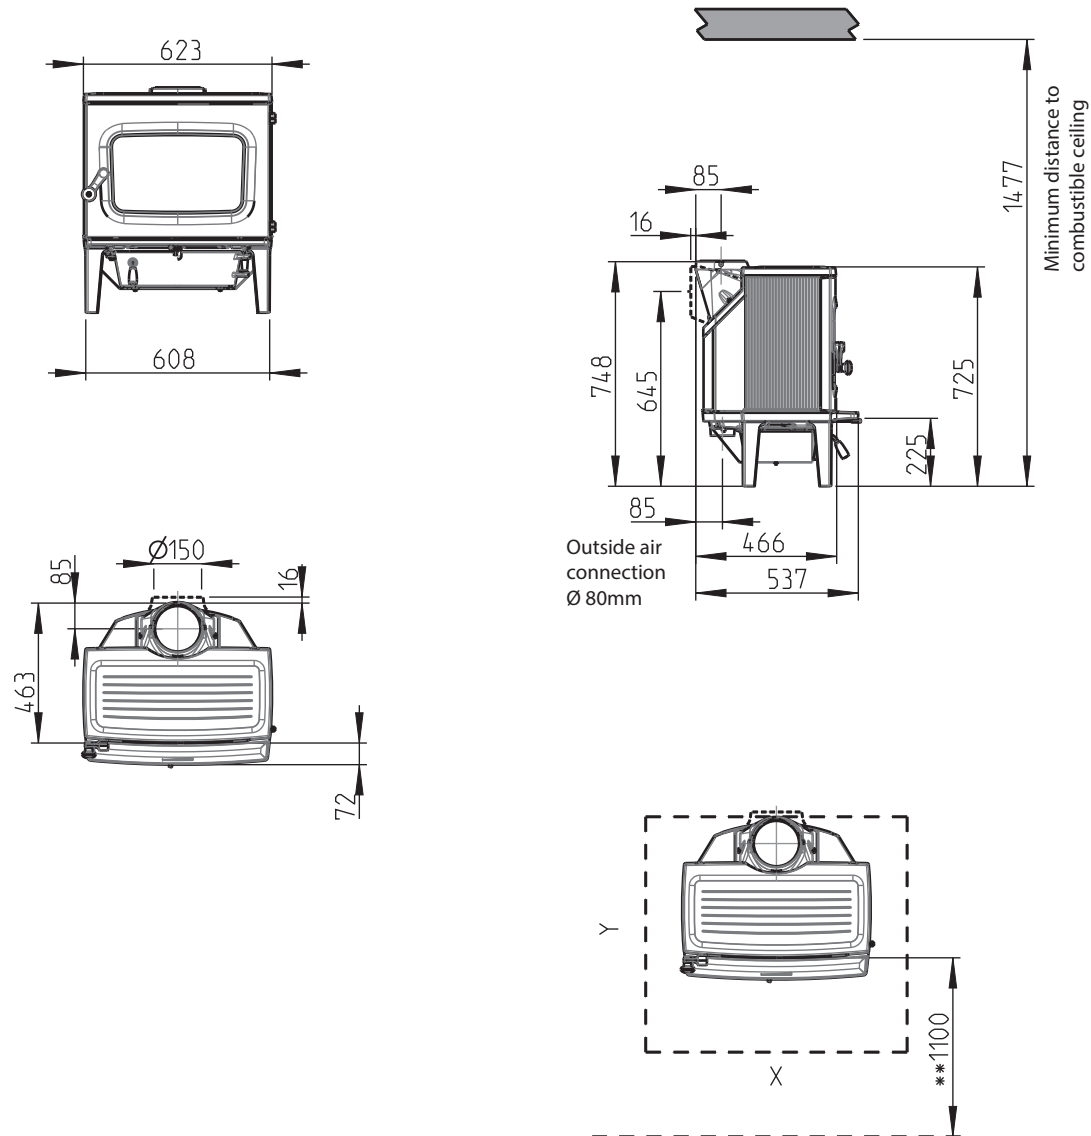

Min. distance to combustible wall

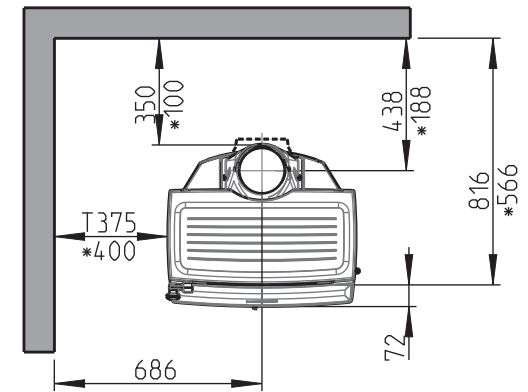

*With semi-insulated flue pipe and extra heatshield
T = Measured from the top plate

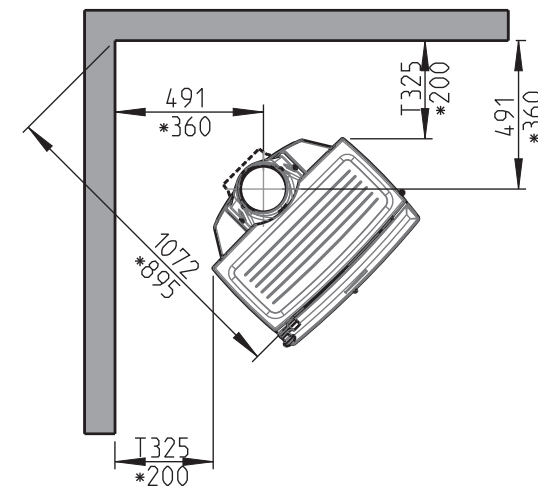

Minimum measurements floorplate X/Y: According to national laws and regulations
**Minimum distance to furniture/combustible materials

Combustible wall

Firewall (see chapter 3.4 in the manual)

Jøtul F 405

Min. distance to combustibile wall protected by firewall

